


# 2HP/230V/1PH CONTROL PANEL

**CAUTION**  
ALL ELECTRICAL WORK  
MUST BE PERFORMED  
BY A LICENSED  
ELECTRICIAN

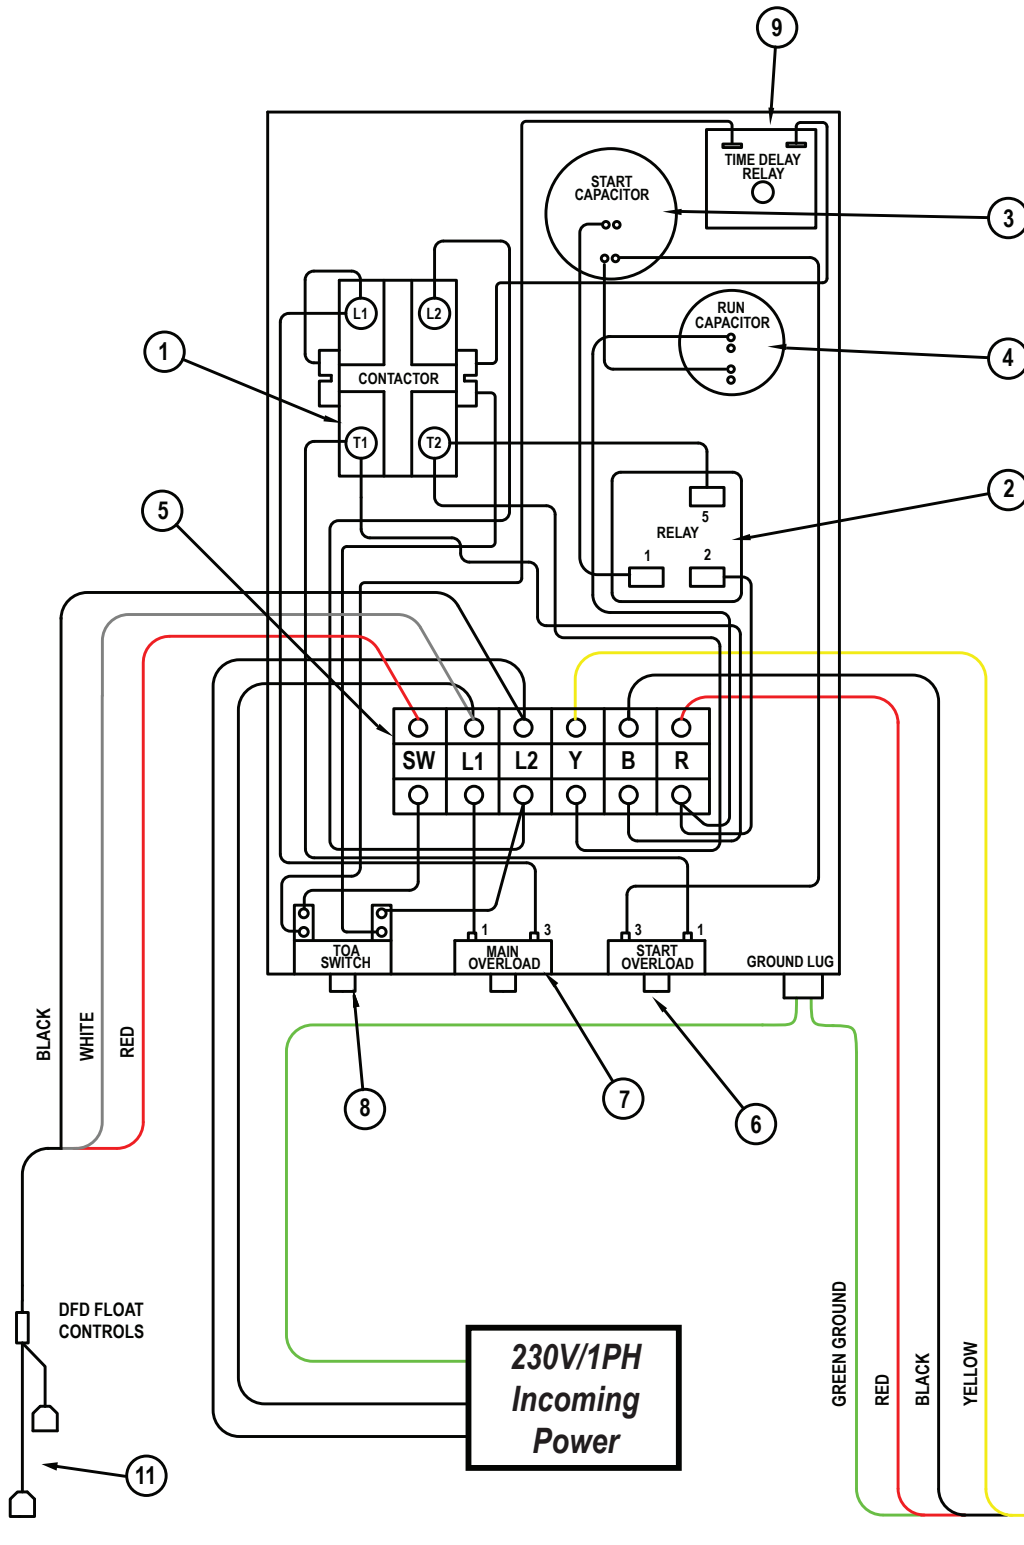

## ENCLOSURE DIMENSIONS

8" wide  
10" high  
6" deep




Carry Pumps, Inc. • 1360 Prospect Avenue • Caro, MI 48723  
www.carrypumps.com • (800) 492-2779 • sales@carrypumps.com


# 2HP/230V/1PH CONTROL PANEL

## IF FLOATS ARE NOT BEING USED


Insert a jumper wire between SW and L2 on the terminal strip.

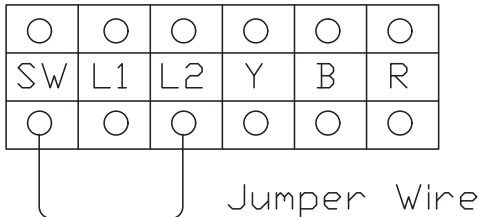

## \*\* OPTIONAL \*\* LOW WATER LEVEL "OFF" FLOAT

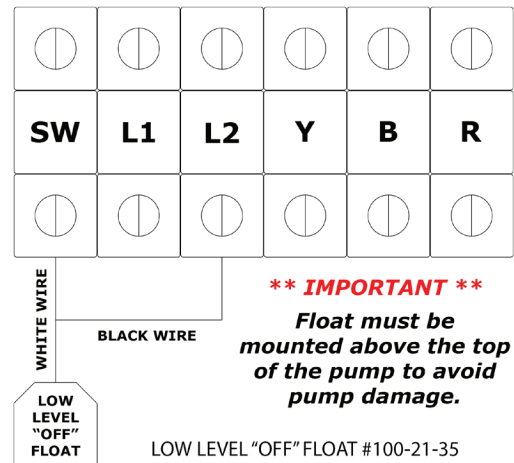

## \*\* OPTIONAL \*\* TIMER 24/7 220V

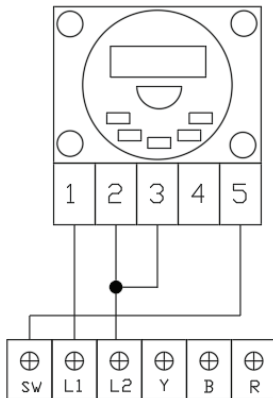

### CONNECTIONS

1. Timer (1) to Control Panel (L1)
2. Timer (2) to Control Panel (L2)
3. Timer (3) to Control Panel (L2)
4. Timer (5) to Control Panel (SW)



#TIMER-24/7-220V-RD

## STANDARD REPLACEMENT PARTS

ITEM #	DESCRIPTION	PART #	QTY
1	CONTACTOR	155-325-102	1
2	RELAY	155-031-102	1
3	START CAPACITOR	275-464-113	1
4	RUN CAPACITOR	155-328-103	1
5	TERMINAL BLOCK	155-762-101	1
6	START OVERLOAD	275-411-107	1
7	MAIN OVERLOAD	275-411-113	1
8	AUTO-OFF-TEST SWITCH SWITCH CONTACT BLOCK	SQDQB4BD8 SQDZB4BZ103	1 1
10	TIME DELAY (OPTIONAL)	ICM203	1
11	DOUBLE FLOAT - PUMP DOWN	100-20-60	1